

# ZHEJIANG ANIX VALVE TECHNOLOGY CO.,LTD

LONGWAN INDUSTRIAL BASE LONGWAN WENZHOU ,(Area 3,Valves Base) CHINA

Mill Test Certificate

Report No.:AN-1908017

Date:Aug 26th 2019

Order No.:AN-M-2019-0826

TO:Unimech Engineering (M) Sdn Bhd


## 1、 Chemical And Tensile Requirements

Description	Material: ASTM A351 CF8M	Heat NO.	QTY (PCS)	Chemical Composition %								Tension Test		
				C	Min	Si	P	S	Cr	Ni	Mo	Yield Strength ≥205Mpa	Tensile Strength ≥485Mpa	Elongation ≥30%
Flange Globe Valve CF8M 10K		R26	5	≤0.08	≤1.50	≤1.50	≤0.04	≤0.04	18-21	9-12	2-3	232	544	40

## 2、 Pressure Test And The Results

Detection Project	Media	Measured Values (Mpa)	Duration (s)	Test Results	Results
Shell Test	Water	3.0MPa	≥60	No Leak	Qualified
Seal Test	Water	2.2MPa	≥60	Qualified	Qualified
Test Standard	API 598 ( valve inspections and tests )				

We certify that the material has been sampled, tested, and inspected with provisions of the above referenced.

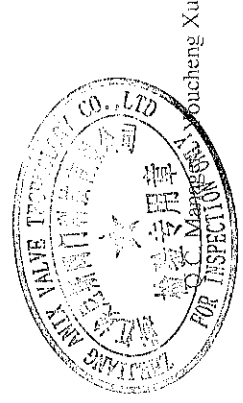

Youcheng Xu