

# ZHEJIANG ANIX VALVE TECHNOLOGY CO.,LTD

LONGWAN INDUSTRIAL BASE LONGWAN WENZHOU ,(Area 3,Valves Base) CHINA

Mill Test Certificate

Report No.:AN-2106011

Date:June 22nd 2021

TO:Unimech Engineering (M) Sdn Bhd


Order No.:AN-M-2021-0622

## 1. Chemical And Tensile Requirements

Description	Material: ASTM A351 CF8M						Chemical Composition %						Tension Test		
	Size	Heat NO.	QTY (PCS)	C	Mn	Si	P	S	Cr	Ni	Mo	Yield Strength $\geq 205\text{Mpa}$	Tensile Strength $\geq 485\text{Mpa}$	Elongation $\geq 30\%$	
Flange Y-Strainer 150LB With Plug,60Mesh	1"	M10410	10	$\leq 0.08$	$\leq 1.50$	$\leq 1.50$	$\leq 0.04$	$\leq 0.04$	18-21	9-12	2-3	241	546	40	

## 2. Pressure Test And The Results

Detection Project	Media	Measured Values (Mpa)	Duration (s)	Test Results	Results
Shell Test	Water	3.0MPa	$\geq 60$	No Leak	Qualified
Seal Test	/				
Test Standard	API 598 (valve inspections and tests )				

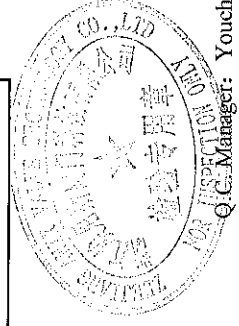

We certify that the material has been sampled, tested, and inspected with provisions of the above referenced.

Q.C. Manager: Youcheng Xu