

# ZHEJIANG ANIX VALVE TECHNOLOGY CO.,LTD

LONGWAN INDUSTRIAL BASE LONGWAN WENZHOU ,(Area 3, Valves Base) CHINA

Mill Test Certificate

Report No.:AN-2205007

Date:May 9th 2022

TO:Unimech Engineering (M) Sdn Bhd

Order No.:AN-M-2022-0509


## 1、 Chemical And Tensile Requirements

Description	Material: ASTM A351 CF8	Size	Heat NO.	QTY (PCS)	Chemical Composition %										Tension Test		
					C	Mn	Si	P	S	Cr	Ni	Mo	Yield Strength $\geq 205\text{Mpa}$	Tensile Strength $\geq 485\text{Mpa}$	Elongation $\geq 35\%$		
FLANGE Y-SRTAINER,60 MESH 10K		2-1/2"	11217	4	$\leq 0.08$	$\leq 1.50$	$\leq 2.00$	$\leq 0.04$	$\leq 0.04$	$\leq 0.04$	18-21	8-11	$\leq 0.50$	247	564	40	
		6"	20231	10	0.05	0.98	1.26	0.03	0.012	18.25	8.12	0.17	243	539	41		

## 2、 Pressure Test And The Results

Detection Project	Media	Measured Values (Mpa)	Duration (s)	Test Results	Results
Shell Test	Water	3.0MPa	$\geq 60$	No Leak	Qualified
Seal Test	/				
Test Standard	API 598 (valve inspections and tests)				

We certify that the material has been sampled, tested, and inspected with provisions of the above referenced.

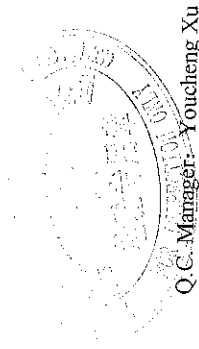

Q.C. Manager: Youcheng Xu