

ZHEJIANG ANIX VALVE TECHNOLOGY CO.,LTD

LONGWAN INDUSTRIAL BASE LONGWAN WENZHOU ,(Area 3, Valves Base) CHINA

Mill Test Certificate

Report No.:AN-2205008

TO:Unimech Engineering (M) Sdn Bhd

Order No.:AN-M-2022-0509

Date:May 9th 2022


1、 Chemical And Tensile Requirements

Description	Size	Heat NO.	QTY (PCS)	Chemical Composition %								Tension Test			
				C	Mn	Si	P	S	Cr	Ni	Mo	Yield Strength ≥ 205 Mpa	Tensile Strength ≥ 485 Mpa	Elongation $\geq 35\%$	
FLANGE Y-SRTAINER,60 MESH 150LB	1"	20215	6	≤ 0.08	≤ 1.50	≤ 2.00	≤ 0.04	≤ 0.04	≤ 0.04	18-21	8-11	≤ 0.50	250	540	41
	6"	20216	6	0.055	0.88	0.99	0.015	0.007	0.03	18.33	8.09	0.23	235	549	40

2、 Pressure Test And The Results

Detection Project	Media	Measured Values (Mpa)	Duration (s)	Test Results	Results
Shell Test	Water	3.0MPa	≥ 60	No Leak	Qualified
Seal Test	/				
Test Standard	API 598 (valve inspections and tests)				

We certify that the material has been sampled, tested, and inspected with provisions of the above referenced.

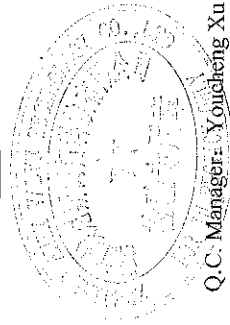

Q.C. Manager: Yongcheng Xu