

# ZHEJIANG ANIX VALVE TECHNOLOGY CO.,LTD

LONGWAN INDUSTRIAL BASE LONGWAN WENZHOU ,(Area 3, Valves Base) CHINA

Mill Test Certificate

Report No.:AN-2205010

Date:May 9th 2022

Order No.:AN-M-2022-0509

TO:Unimech Engineering (M) Sdn Bhd


## 1、 Chemical And Tensile Requirements

Material: ASTM A351 CF8M		Chemical Composition %								Tension Test				
Description	Size	Heat NO.	QTY (PCS)	C	Min	Si	P	S	Cr	Ni	Mo	Yield Strength $\geq 205\text{Mpa}$	Tensile Strength $\geq 485\text{Mpa}$	Elongation $\geq 30\%$
				$\leq 0.08$	$\leq 1.50$	$\leq 1.50$	$\leq 0.04$	$\leq 0.04$	18-21	9-12	2-3			
Y-STRAINER 800PSI BSPT	1/2"	20234	300	0.055	0.74	1.09	0.026	0.012	18.19	9.2	2.12	233	536	40

## 2、 Pressure Test And The Results

Detection Project	Media	Measured Values (Mpa)	Duration (s)	Test Results	Results
Shell Test	Water	8.3MPa	$\geq 60$	No Leak	Qualified
Seal Test		/			
Test Standard	API 598 (valve inspections and tests )				

We certify that the material has been sampled, tested, and inspected with provisions of the above referenced.

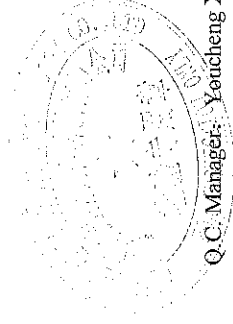

Q.C. Manager: Yencheng Xu